


Meter Wiring Single Phase Residential Day/Night Options 2 Rate

OBSOLETE FOR NEW INSTALLS (Refer MX-000131-04)

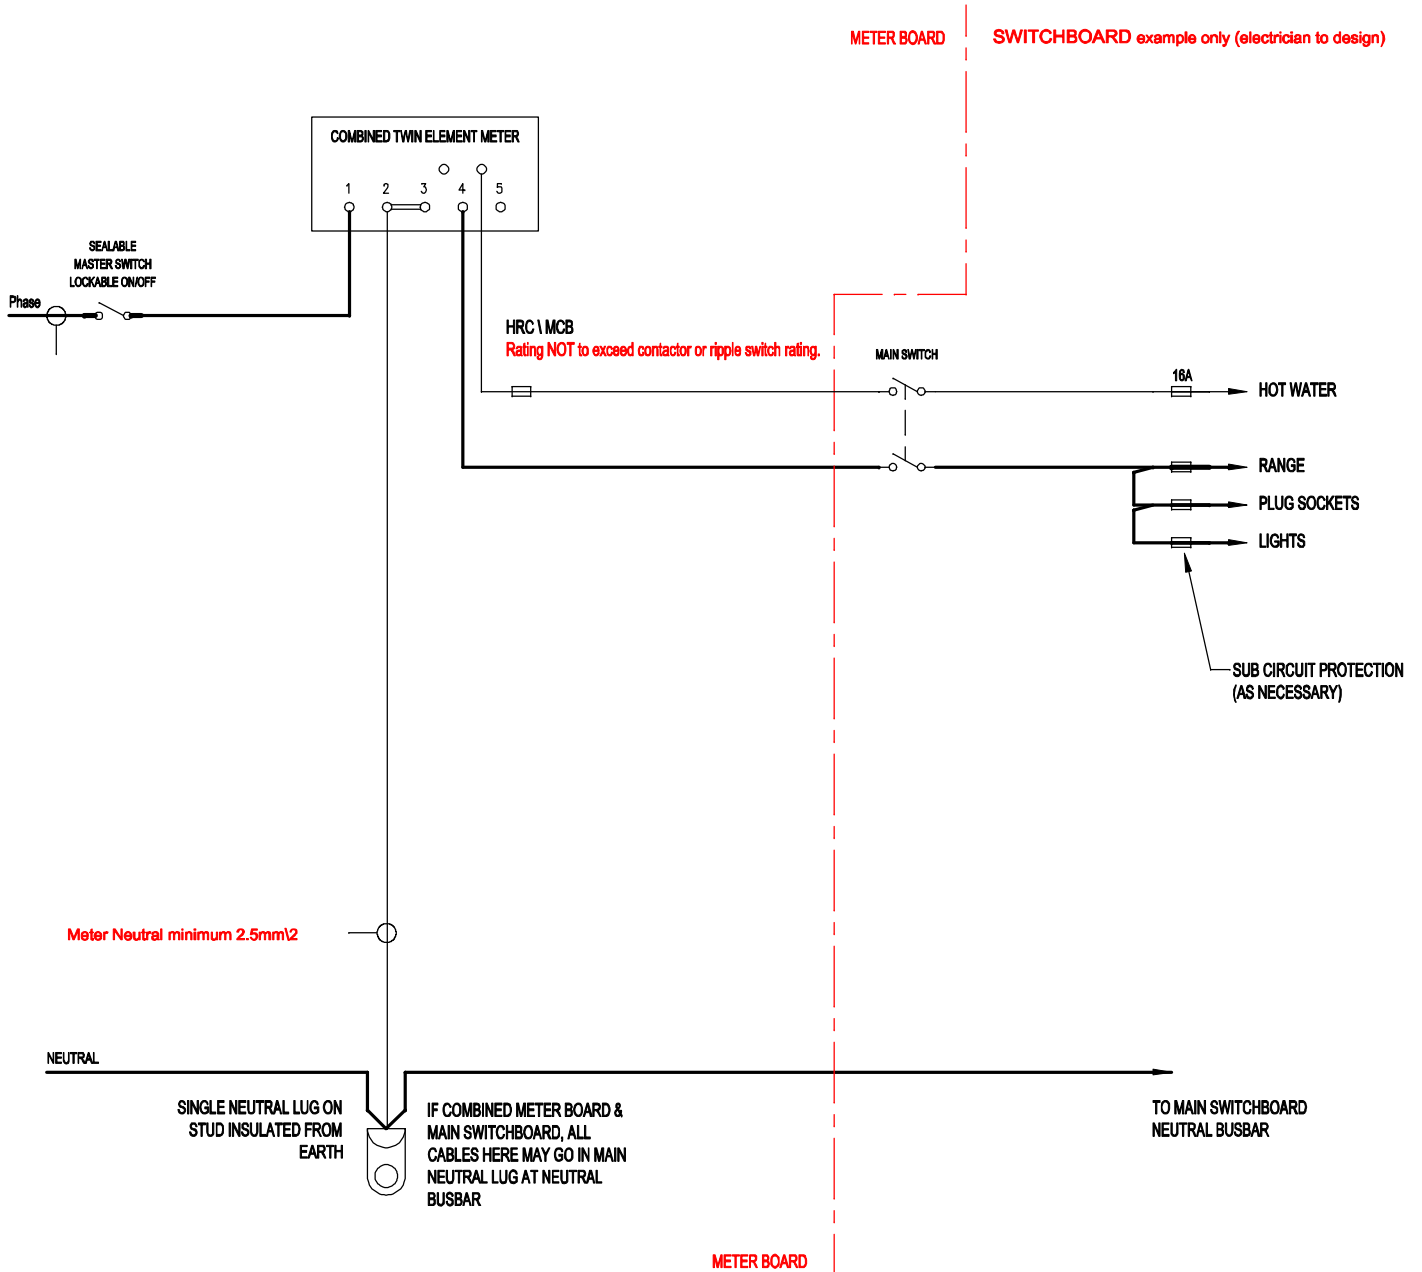

NOTES: *Test house
*1. LEAVE ALL TERMINALS MARKED 'X' CLEAR.

2. If higher capacity is required than the ripple relay switch, the relay must switch the load via a contactor connected at customers distribution board (customer owned / maintained). Wiring between ripple relay & customers distribution board to correspond with the rating of this protection

Metrix requires new meter panel pre-wiring at date of installation to comply with the current Electrical Wiring Regulations that are applicable
Metrix drawings show configurations for correct tariff requirements. Cable size / circuit protection to be as per regulations

© Copyright Metrix 2012

△	GENERAL REVISION	BG	MK	May 2012
△	TEXT NOTES	ND	BC	May 2002
△	GENERAL ISSUE	ND	BC	Dec 2000
REV	DESCRIPTION OF REVISION	BY	CHK	DATE

METRIX
42 OLIVE RD PENROSE
PRIVATE BAG 92008 AUCKLAND
Phone: (09) 580 3900 Fax: (09) 580 394

Meter Wiring Single Phase Residential Day/Night Options 2 Rate			SCALE N.T.S
DRAWING CONTINUED ON SHEET:			
Designed METRIX	Checked B. CAMERON	Date Dec 2000	DRAWING NUMBER MX-000131-03
Drawn N. DUKE	Approved T. DeVILLIERS	Card File Name MX00013103.DWG	REVISION C