


Meter Wiring Three Phase Residential Options With Controlled Hot Water

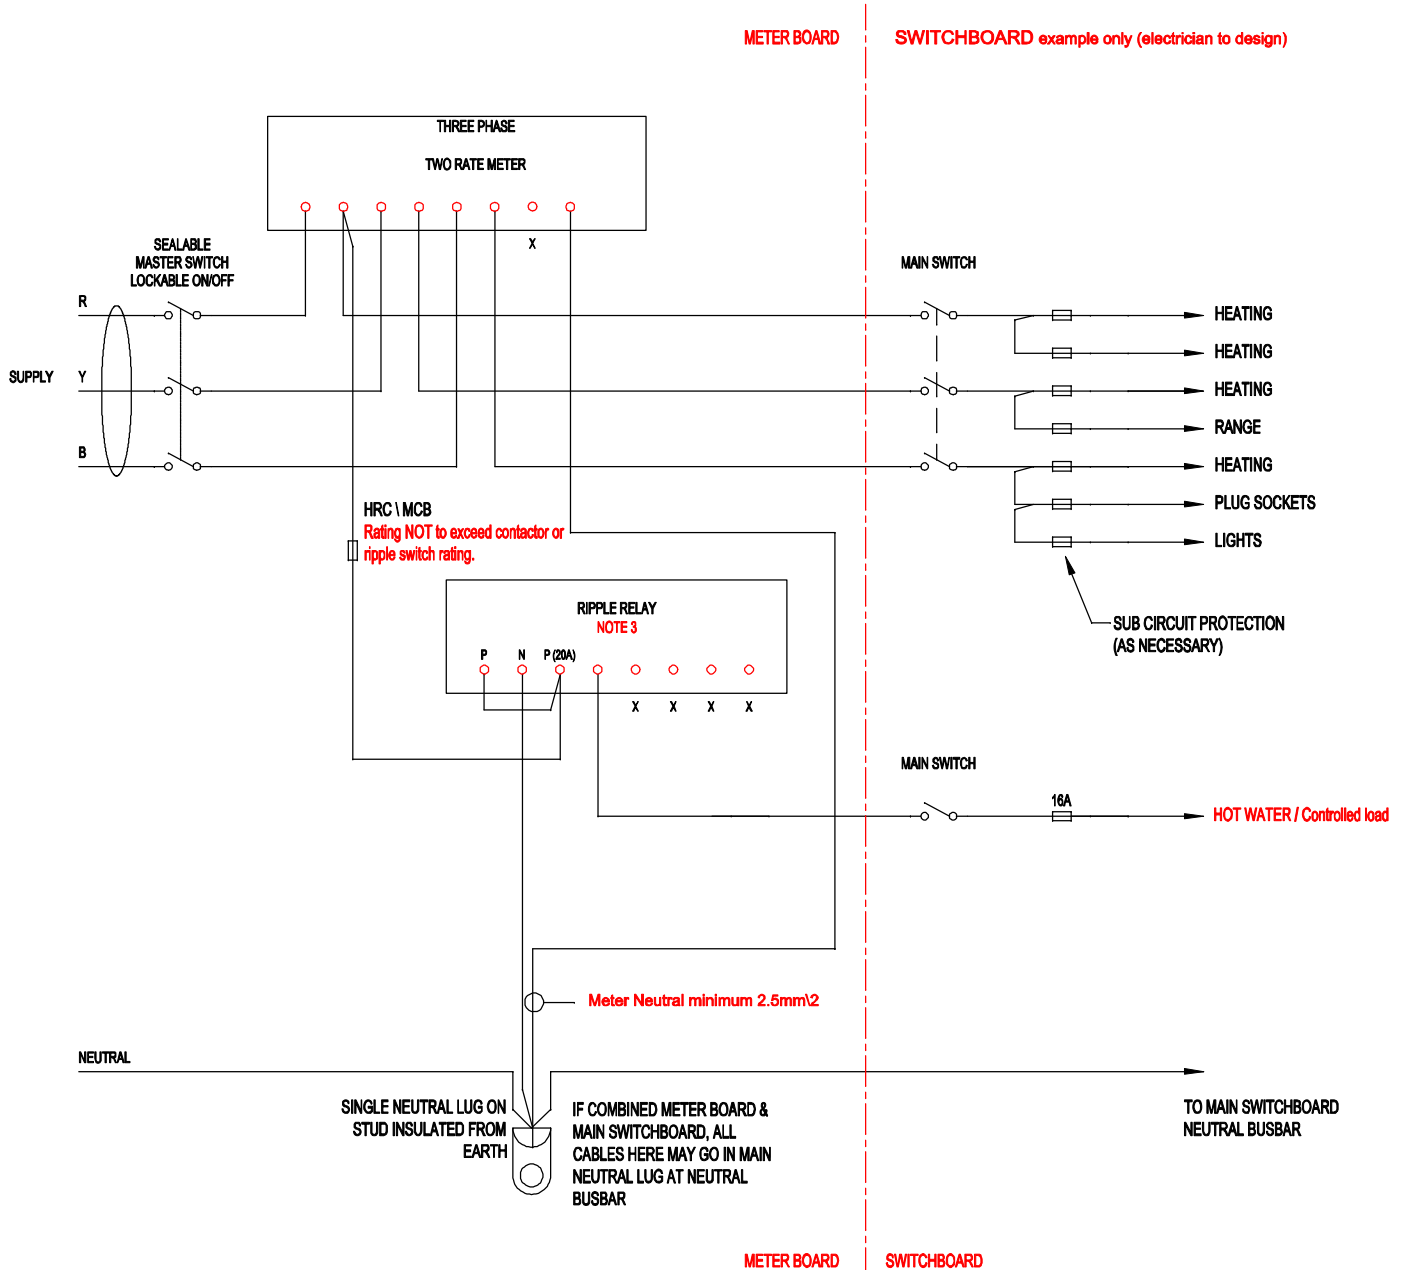

NOTES: *Test house

- *1. LEAVE ALL TERMINALS MARKED 'X' CLEAR.
- *2. A SEPARATE METER FOR "OTHER PERMANENTLY WIRED APPLIANCES" MAY BE ADDED TO THIS OPTION.
- 3. THE RIPPLE RELAY SWITCHES SHALL BE POSITIONED TO CORRESPOND WITH THE APPROPRIATE CHANNEL CODE FOR THE DESIRED SERVICE LEVEL.

If higher capacity is required than the ripple relay switch, the relay must switch the load via a contactor connected at customers distribution board (customer owned / maintained). Wiring between ripple relay & customers distribution board to correspond with the rating of this protection.

Metrix requires new meter panel pre-wiring at date of installation to comply with the current Electrical Wiring Regulations that are applicable. Metrix drawings show configurations for correct tariff requirements. Cable size / circuit protection to be as per regulations

© Copyright Metrix 2012

| | | | | |
|-----|-------------------------|----|-----|----------|
| △ | GENERAL REVISION | BG | MK | May 2012 |
| △ | FUSE ADDED & NOTES | ND | BC | May 2002 |
| △ | GENERAL ISSUE | ND | BC | Dec 2000 |
| REV | DESCRIPTION OF REVISION | BY | CHK | DATE |

METRIX

42 OLIVE RD PENROSE
PRIVATE BAG 92008 AUCKLAND
Phone: (09) 580 3900 Fax: (09) 580 394

| | | | |
|---|------------------------|-------------------------------|----------------|
| Meter Wiring Three Phase Residential Options With Controlled Hot Water | | | SCALE N.T.S |
| DRAWING CONTINUED ON SHEET: | | | |
| Designed METRIX | Checked B. CAMERON | Date Dec 2000 | DRAWING NUMBER |
| Drawn N.DUKE | Approved T. DeVILLIERS | Card File Name MX00013302.DWG | REVISION C |
| | | | MX-000133-02 |