


Recommended Wiring of Builders Temporary Supply

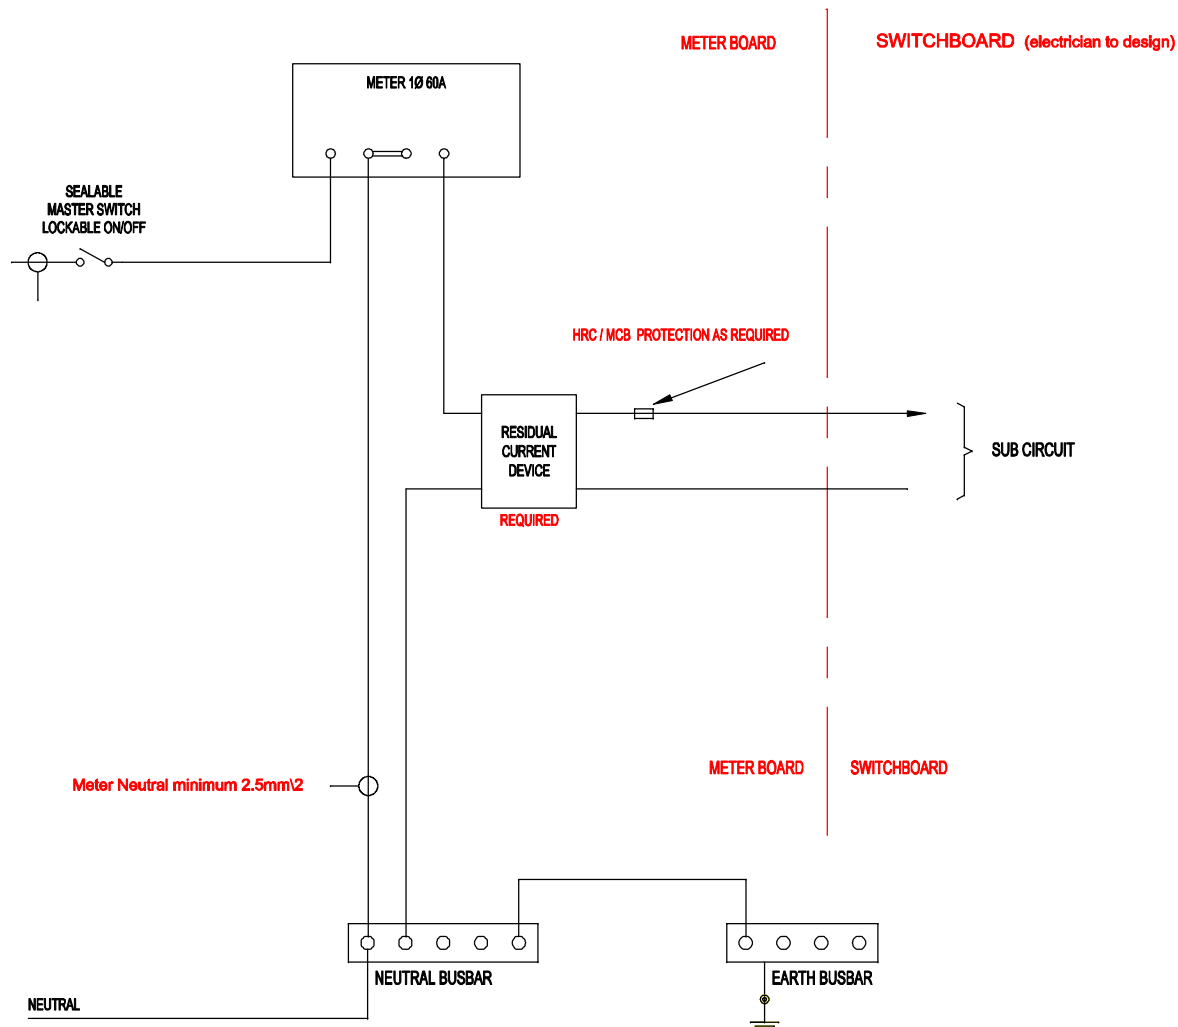

NOTES:

1. A MINIATURE CIRCUIT BREAKER MAY BE USED IN LIEU OF THE MAIN SWITCH PROVIDED IS IS THE "SWITCH-RESET" TYPE
2. MINIMUM SERVICE MAIN SIZE OF 16mm² MAY BE REDUCED TO 4mm² WHERE EITHER THE LENGTH OF RUN IS UNDER 2m OR WHERE A CIRCUIT BREAKER IS EMPLOYED AT THE SWITCHBOARD TO LIMIT THE MAXIMUM DEMAND TO THE CURRENT RATING OF THE CABLE
3. METER TO BE INSTALLED BY REGISTERED ELECTRICAL INSPECTOR ONCE CERTIFICATE OF COMPLIANCE APPROVED. WIRING FOR THE METER SHALL BE LEFT IN AN UNBROKEN LOOP AWITING METER CONNECTION

Metrix requires new meter panel pre-wiring at date of installation to comply with the current Electrical Wiring Regulations that are applicable
 Metrix drawings show configurations for correct tariff requirements. Cable size / circuit protection to be as per regulations

© Copyright Metrix 2012

REV	DESCRIPTION OF REVISION	BY	CHK	DATE
△	GENERAL REVISION	BG	MK	May 2012
△	NOTE ADDED	ND	BC	May 2002
△	GENERAL ISSUE	ND	BC	Dec 2000

METRIX

42 OLIVE RD PENROSE
 PRIVATE BAG 92008 AUCKLAND
 Phone: (09) 580 3900 Fax: (09) 580 394

Designed		Checked		Date	
METRIX		B.CAMERON		Dec 2000	
Drawn N. DUKE		Approved T. DeVILLIERS		Cad File Name MX00014801.DWG	

SCALE	
N.T.S	
DRAWING CONTINUED ON SHEET:	
DRAWING NUMBER	REVISION
MX-000148-01	C