




Meter Wiring Single Phase Residential Options Controlled Cyclo (Z-Lynk) relay

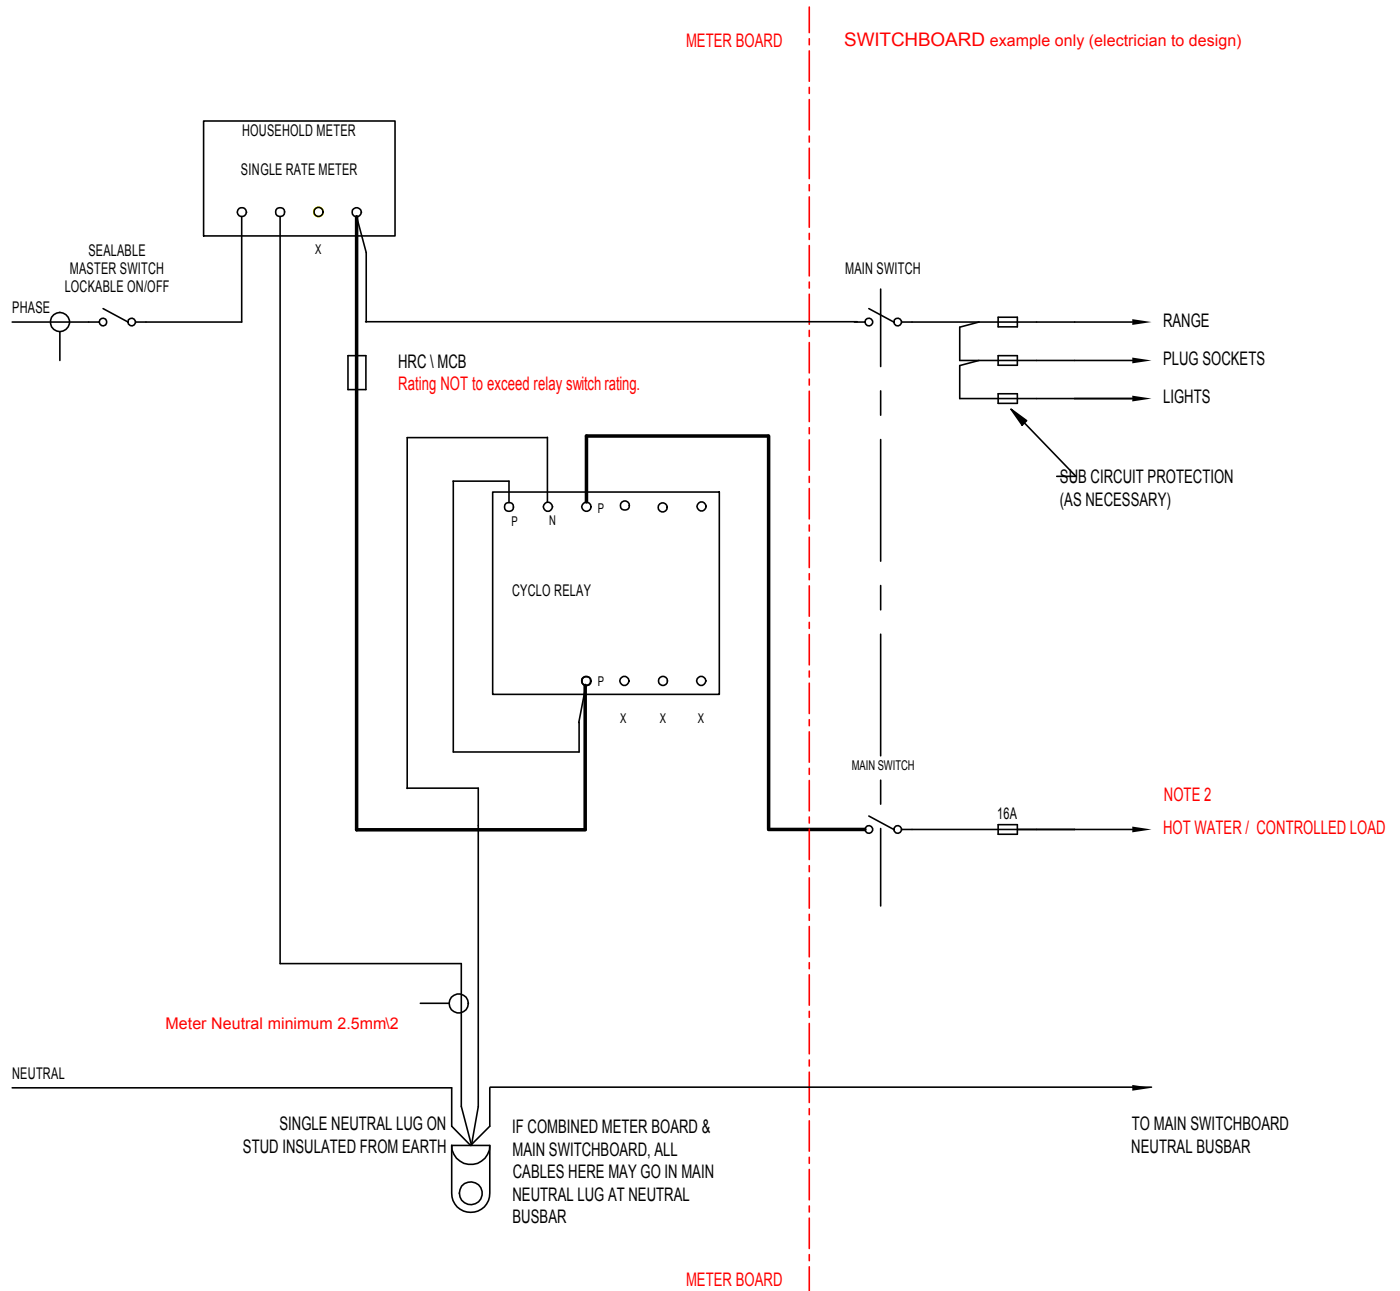

NOTES: *Test house

- *1. LEAVE ALL TERMINALS MARKED 'X' CLEAR.
2. If higher capacity is required than the relay switch, the relay must switch the load via a contactor connected at customers distribution board (customer owned / maintained). Wiring between relay & customers distribution board to correspond with the rating of this protection.

Metrix requires new meter panel pre-wiring at date of installation to comply with the current Electrical Wiring Regulations that are applicable
Metrix drawings show configurations for correct tariff requirements. Cable size / circuit protection to be as per regulations

Copyright Metrix 2013

				METRIX			Meter Wiring Single Phase Residential Options Controlled (Z-Lynk) relay			SCALE N.T.S.	
				42 OLIVE RD PENROSE PRIVATE BAG 92008 AUCKLAND Phone: (09) 580 3900 Fax: (09) 580 394						DRAWING CONTINUED ON SHEET:	
										DRAWING NUMBER MX-000127-00	
										REVISION A	
										Cad File Name MX00012700.DWG	
										Date JUL 2013	
										Approved I.DADI	
										Checked P. THORNTON	
										Designed METRIX	
										Drawn B. GRAVATT	
										By CHK	
										Date JUL 2013	
										By BG	
										Description of Revision	
										General Issue	
										Revision	